

80% GAS FURNACE JOBSITE INFORMATION SHEET

OWNER:

Name: _____
 Street: _____
 City: _____ Zip: _____
 State/Province: _____ Phone: _____

DATE: _____

PROBLEM DESCRIPTION:

SERVICING CONTRACTOR:

Name: _____
 Street: _____
 City: _____ Zip: _____
 State/Province: _____ Phone: _____

DISTRIBUTOR:

Name: _____
 Street: _____
 City: _____ Zip: _____
 State/Province: _____
 Phone: _____

PRODUCT INFORMATION:

Furnace Model Number: _____
 Evaporator Model Number: _____
 Installation Date: _____

Serial #: _____

Serial #: _____

TEMPERATURES: (Figure 1)

- T1-Vent Temperature = _____
 - T2-Return Air = _____
 - T3-Supply Air = _____
 - Temperature Rise (T3-T2) = _____

VENT: (Figure 2)

- Vent Material: Single Wall Double Wall HTPV
 - Common Vent Used? Yes No
 ① Diameter = _____
 ② Total Length = _____
 ③ Term. Length = _____
 ④ Total Height = _____
 - Power Venter Used? Yes No

PRESSURES (Furnace Running): (Figure 1)

- P1-Manifold = _____
 - P2-Inlet Gas = _____
 - P3-Vent Pressure Switch = _____
 - Gas Pipe Diameter = _____
 - LP or Natural Gas = _____
 - Burner Orifice Size = _____

VENT CONNECTION: (Figure 2)

	FURNACE	WATER HEATER
- Material:	Single Wall <input type="checkbox"/>	Single Wall <input type="checkbox"/>
	Double Wall <input type="checkbox"/>	Double Wall <input type="checkbox"/>
	HTPV <input type="checkbox"/>	HTPV <input type="checkbox"/>
⑤ Diameter=	_____	_____
⑥ Height =	_____	_____

HIGH VOLTAGE CIRCUIT READINGS: (Figure 3)

① & ⑥ - Line Voltage _____
 ② & ⑥ - IBM _____
 ③ & ⑥ - IDM _____
 ④ & ⑥ - Transformer _____
 ① & ⑦ - L1 to Earth Ground _____
 ⑥ & ⑦ - Neutral to Earth Ground _____
 ⑤ & ⑥ - HSI Voltage during "warm-up" _____

OTHER NECESSARY DATA: (Figure 2)

- Is return air intake sealed and terminating outside furnace area? _____
 - Fault Code Number of Flashes (Fig. 1) _____
 - Electronic Thermostat? Yes No

LOW VOLTAGE CIRCUIT READINGS: (Figure 4)

⑧ & ⑨ - Transformer Control Voltage _____
 ⑩ to ⑫ - MRLC & LC ⑩ to ⑪: _____ ⑩ to ⑫: _____
 ⑬ & ⑭ - Vent Pressure Switch _____
 ⑮ & ⑯ - Gas Valve _____
 ⑰ - Flame Sensor Micro Amp _____

REQUESTED BY: _____



Figure 1

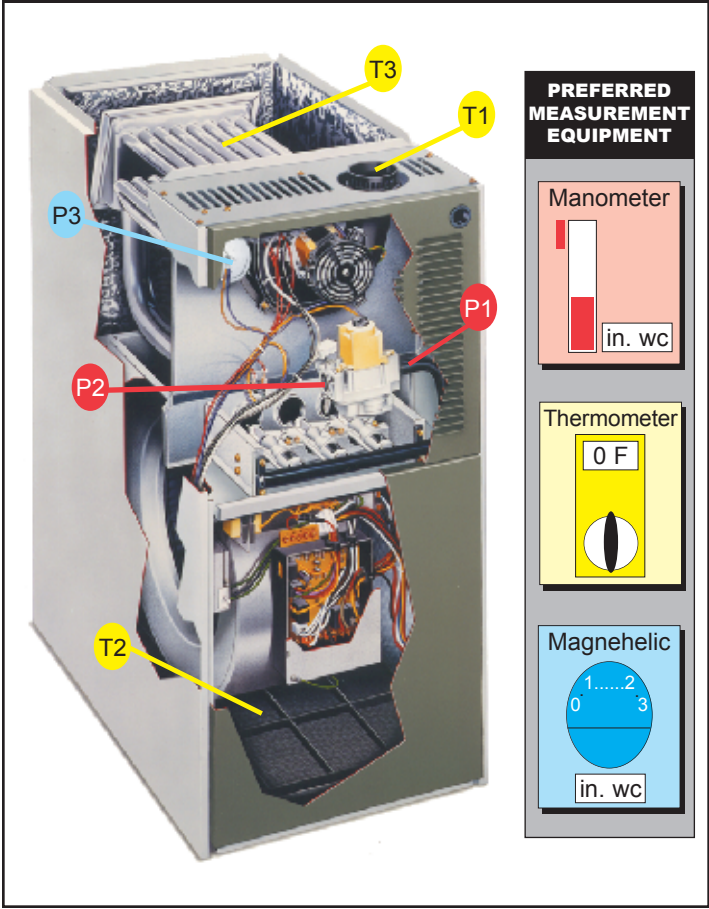


Figure 2

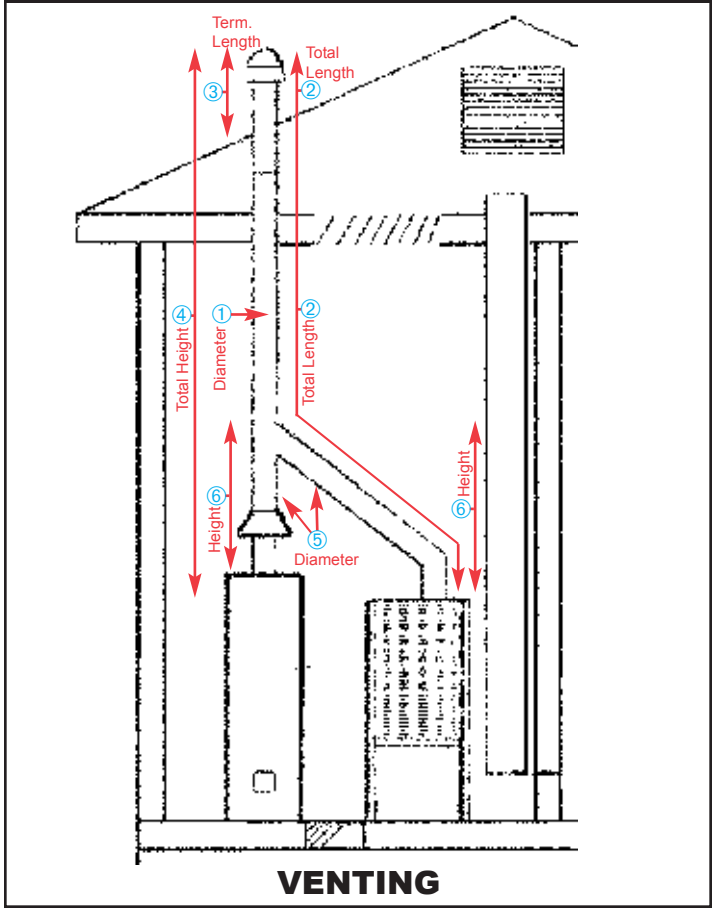


Figure 3

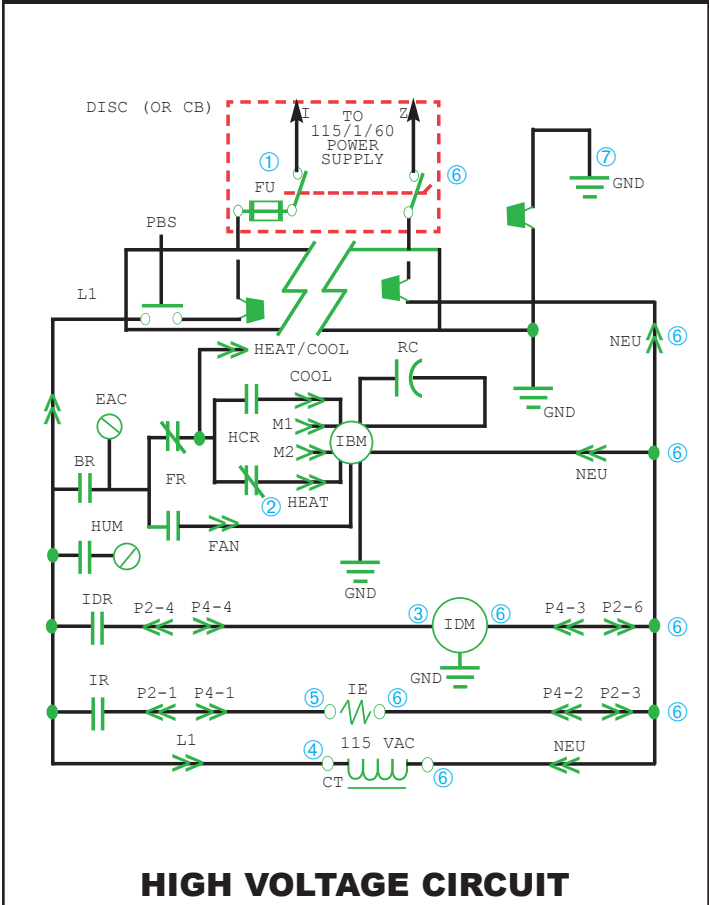


Figure 4

